

查询历史数据账号

保定市第二医院


环境监测历史数据—(阴凉)33011806

○- 节点1-温度(°C)

○- 节点1-湿度(%)

节点1-温度最大值: 16.6 最小值: 14.2 平均值: 15.32

节点1-湿度最大值: 75.8 最小值: 37.5 平均值: 50.38

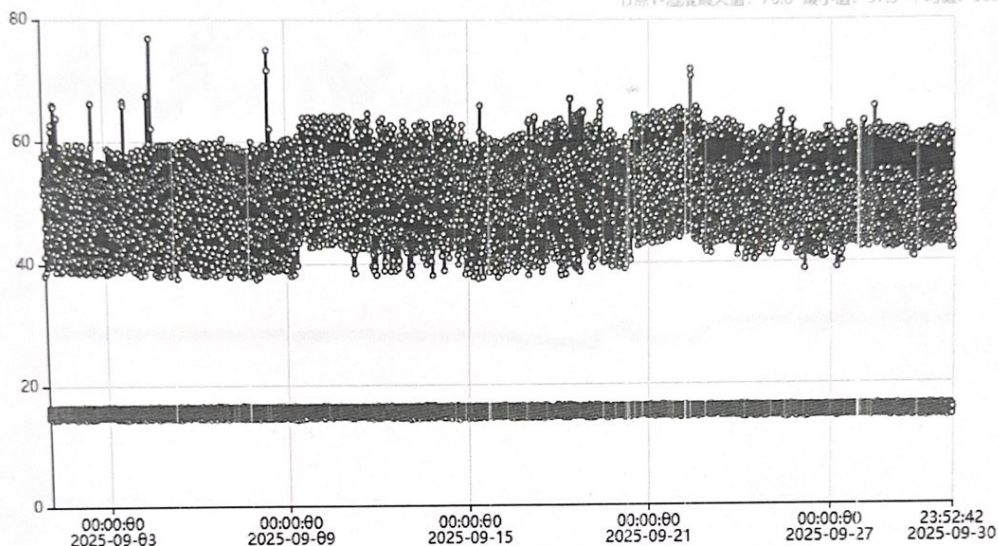

设备地址	设备名称	温度(°C)	湿度(%)	记录时间
33011806	(阴凉)33011806	15.1	38.1	2025-09-01 00:07
33011806	(阴凉)33011806	14.8	53.2	2025-09-01 00:17
33011806	(阴凉)33011806	15.7	57.4	2025-09-01 00:27
33011806	(阴凉)33011806	16.4	51.4	2025-09-01 00:37
33011806	(阴凉)33011806	14.9	41.2	2025-09-01 00:47
33011806	(阴凉)33011806	15.6	49.1	2025-09-01 00:57
33011806	(阴凉)33011806	16.1	53.8	2025-09-01 01:07
33011806	(阴凉)33011806	14.9	38.7	2025-09-01 01:17
33011806	(阴凉)33011806	15.3	46.0	2025-09-01 01:27
33011806	(阴凉)33011806	15.8	52.2	2025-09-01 01:37
33011806	(阴凉)33011806	16.1	43.9	2025-09-01 01:47
33011806	(阴凉)33011806	15.0	43.1	2025-09-01 01:57
33011806	(阴凉)33011806	15.6	49.8	2025-09-01 02:07